
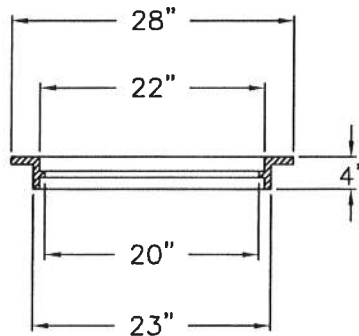



Lid Shall Be Lettered
"Storm Drain"

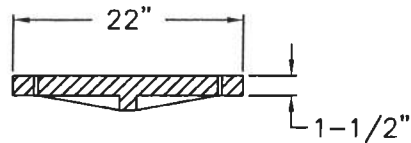

Notes:

1. Casting Shall Conform To ASTM A-48-64 Class 35B Iron Minimum.
2. Casting Shall Have Ground Or Machined Bearing Surfaces.
3. Casting Shall Be Of Uniform Quality, Free From Blow Holes, Porosity, Hard Spots, Shrinkage Defects, Or Other Injurious Defects.
4. Casting Shall Be Light Duty Sidewalk Type.
5. "Pick Holes" Are Required In Lid.
6. Frame And Cover Shall Be 1545Z1 & 1544C As Manufactured By East Jordan Iron Works, P.O. Box 439 Spring St. East Jordan, Mich. 49727, Or An Approved Equal.

APPROVAL	REVISED	TOWN OF EASTON AND EASTON UTILITIES STANDARD DETAILS INLET FRAME & COVER
 EU MANAGER OF ENGINEERING DATE	OCT 1, 88	
	AUG 1, 94	
	FEB 1, 06	
ISSUED: MAY 1, 1986		STANDARD NO. SD-3.00